



Certificate of Accreditation

Sewage Management Facility

Sewage Ejection Pump Station

This Certificate of Accreditation is issued by the Secretary of the NSW Ministry of Health pursuant to Clause 41(1) of the Local Government (General) Regulation 2005.

Manufacturer: *Neatport Pty Ltd TA Suncoast Waste Water Management*

Of: *59 Industrial Ave, Kunda Park, QLD, 4556*

The Ozzi Kleen Models of Sewage Ejection Pump Stations as described in the following Schedule have been accredited as sewage management facilities for use in single domestic premises in NSW.

*Director, Environmental Health
for Secretary (delegation PH335)*

Issued: *6 August 2019*

Certificate No: *SEPS008*

Expires: *31 December 2023*



Accreditation Schedule

The Certificate of Accreditation applies to the following sewage ejection pump stations.



The following Ozzi Kleen models of Roto moulded polyethylene sewage ejection pump stations of:

- *Model PSS1000 of 1000L nominal capacity, flat or hopper base, with a single pump*
- *Model PSS1500 of 1500L nominal capacity, flat or hopper base, with a single pump*
- *Model PSS4000 of 4000L nominal capacity, flat or hopper base with dual pumps*

Each Model consists of:

- *A vertical axis type cylindrical rotational moulded polyethylene pump well and lid, manufactured to AS1546.1:2008.*
- *A single or dual Bianco PUMPZBIA-PDG150M positive displacement grinder pump (or equivalent), fitted with water level and high water level floats.*
- *A check valve and gate valve fitted on the outlet of the grinder pump. The discharge pipe is connected to a 32mm or 40mm diameter uPVC or poly pipe to the sewer.*
- *An audible and visible alarm with mute facility.*

ACCREDITED
 - 6 AUG 2019
 NSW MINISTRY OF HEALTH

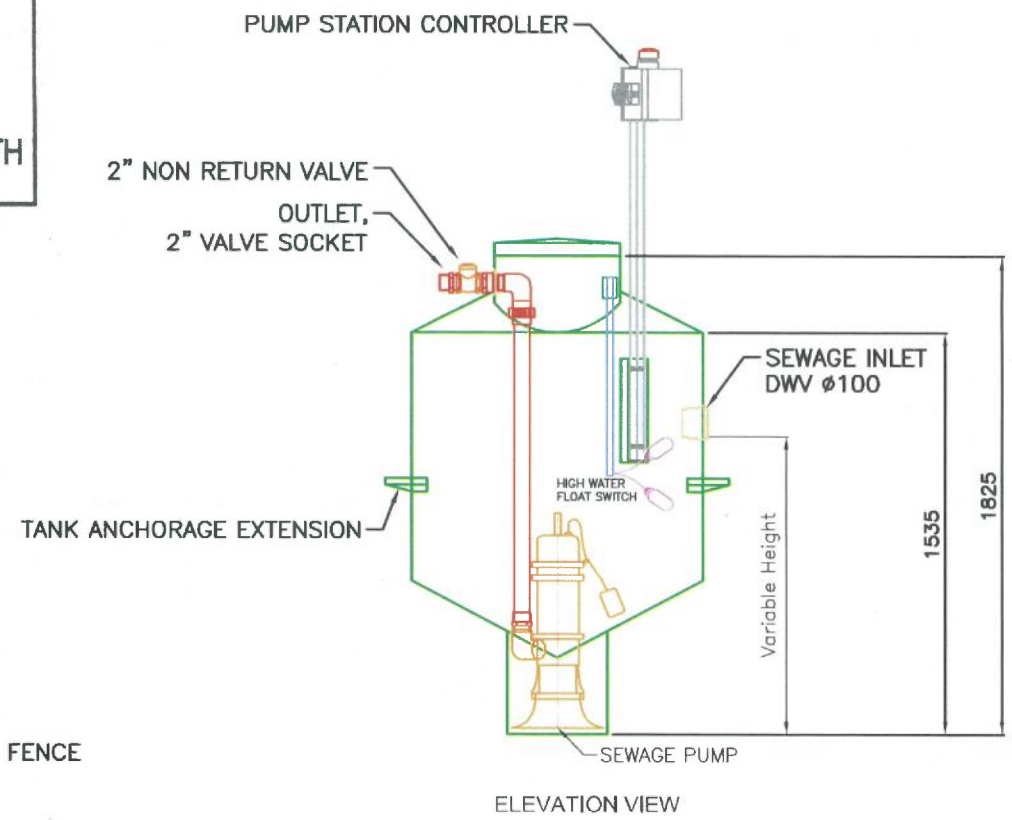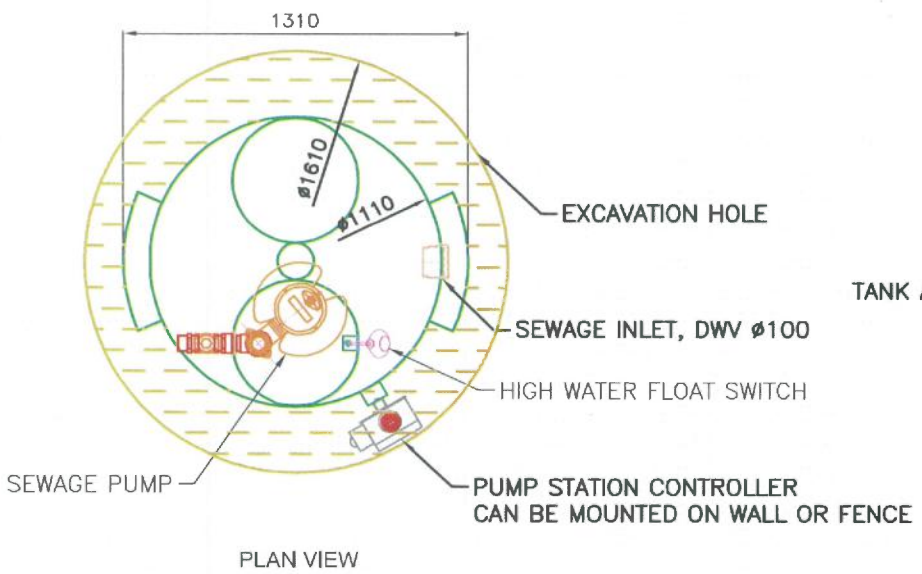

21/04/17	GENERAL REVISION	1	YH
DATE	DESCRIPTION	REV.	BY





Suncoast Waste Water Management

59 INDUSTRIAL AVE
 KUNDA PARK
 QLD 4556
 PH +61 7 5459 4900
 FAX +61 7 5456 4677
 www.ozzicleen.com

CLIENT	GENERAL	DESIGN	AP
PROJECT	PRESSURE SEWER SYSTEM PSS1000	DRAWN	YH
TITLE	GENERAL LAYOUT	CHKD	AP
DWG NO.	GD-PSS1000_SP-H10	DATE	21/04/17
		SCALE	NTS

ACCREDITED
 - 6 AUG 2019
 NSW MINISTRY OF HEALTH

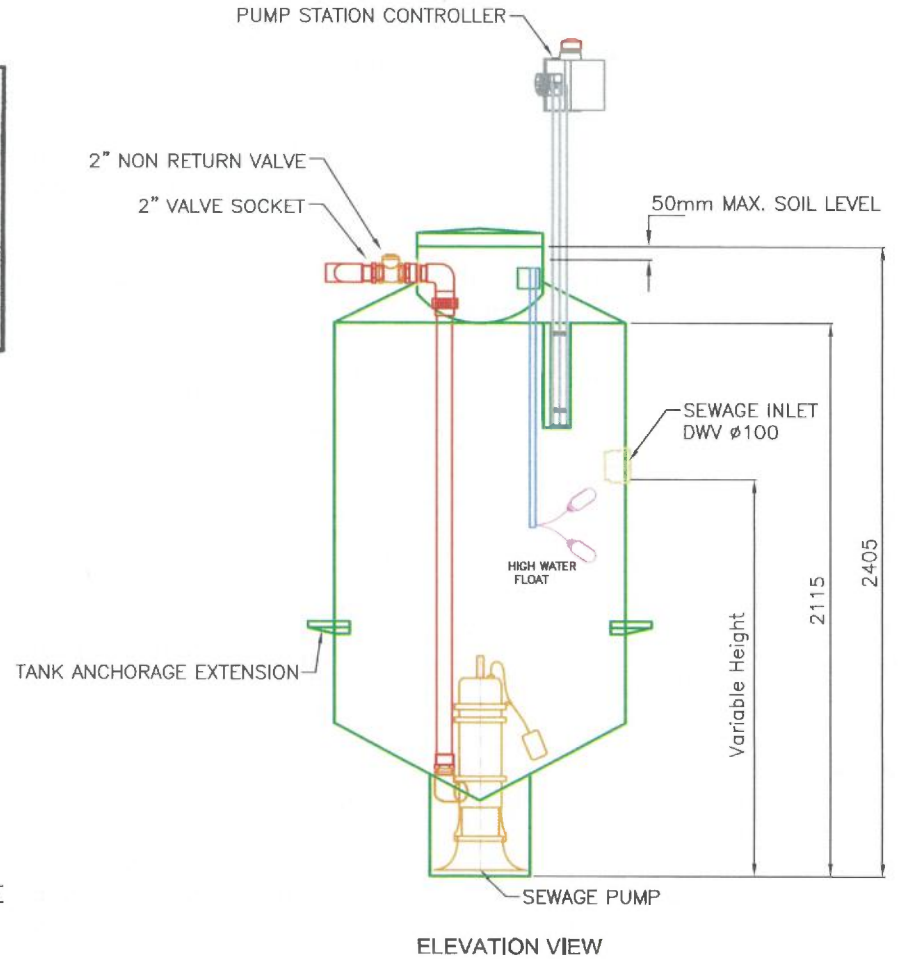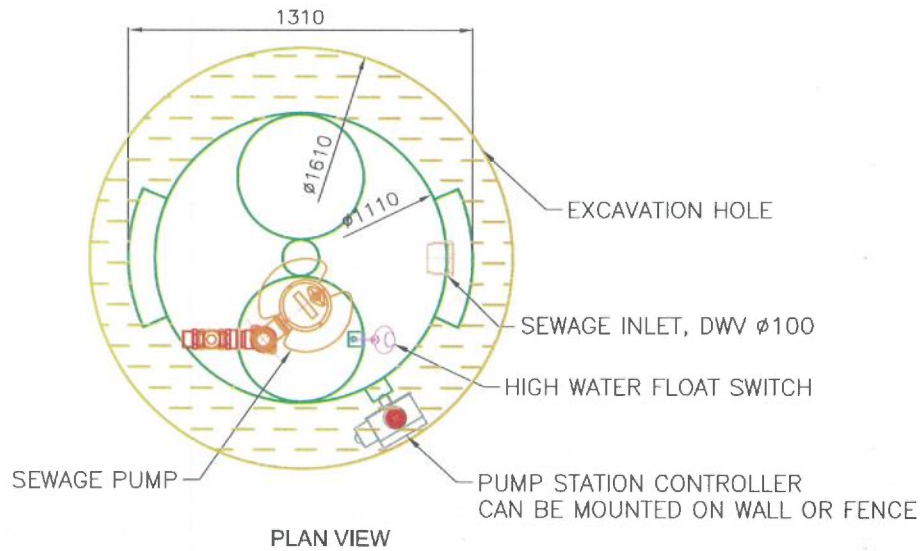

DATE	DESCRIPTION	REV.	BY
25/07/19	GENERAL REVISION	2	YH
21/04/17	GENERAL REVISION	1	YH




59 INDUSTRIAL AVE
 KUNDA PARK
 QLD 4556
 PH +61 7 5459 4900
 FAX +61 7 5458 4677
 www.ozziclean.com


Suncoast Waste Water Management

CLIENT	GENERAL	DESIGN	AP
DRAWN			YH
PROJECT	PRESSURE SEWER SYSTEM PSS1500	CHKD	AP
TITLE	GENERAL LAYOUT	DATE	25/07/19
DWG NO.	GD-PSS1500_SP-H10	SCALE	NTS

ACCREDITED
 - 6 AUG 2019
 NSW MINISTRY OF HEALTH

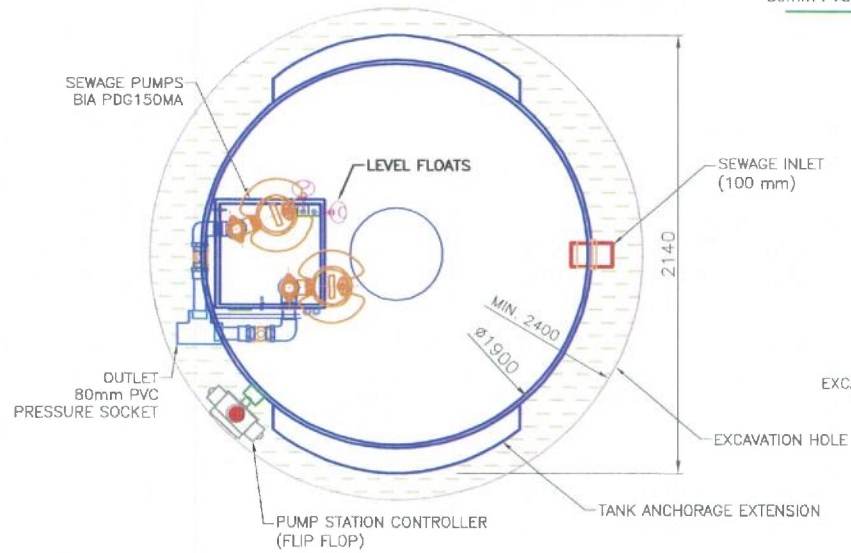

PLAN

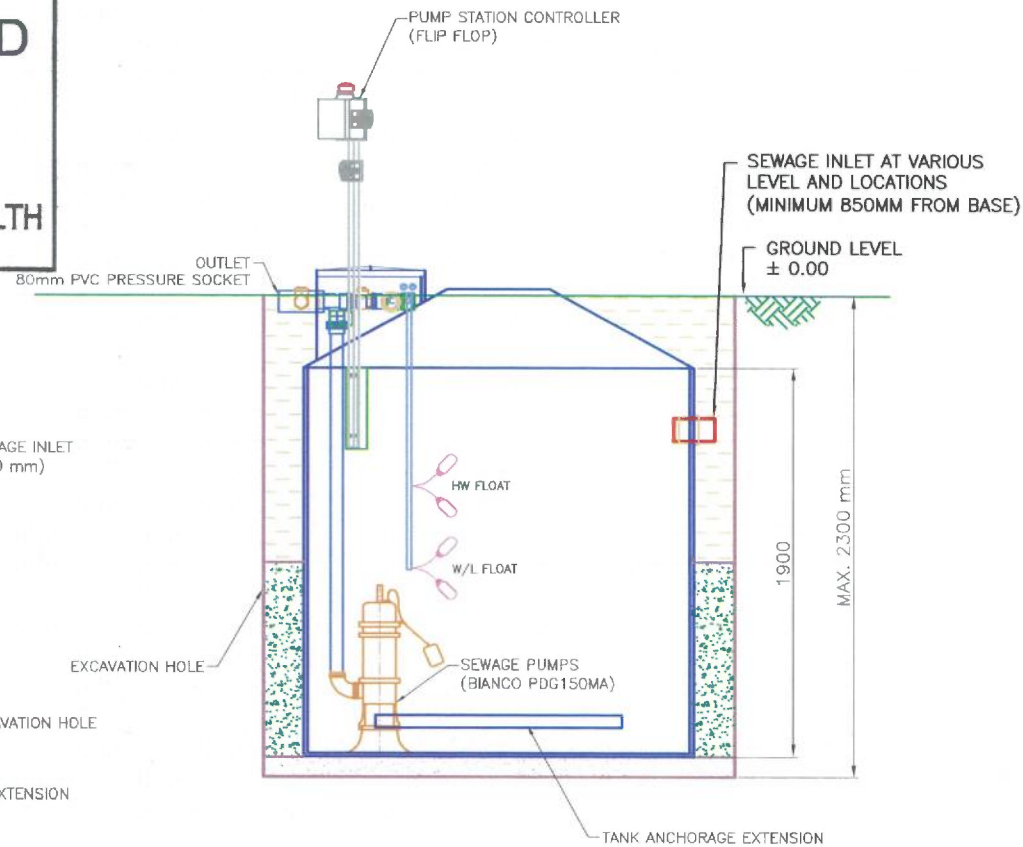

ELEVATION

DATE	DESCRIPTION	REV.	BY
06/04/18	GENERAL REVISION	1	YH



Suncoast Waste Water Management

59 INDUSTRIAL AVE
 KUNDA PARK
 QLD 4556
 PH +61 7 5459 4900
 FAX +61 7 5456 4677
 www.ozzikleen.com

CLIENT	GENERAL	DESIGN	AP
PROJECT	PSS4000 Pressure Sewer System	DRAWN	YH
TITLE	GENERAL LAYOUT	CHKD	AP
DWG NO.	GD-PSS4000_FF-H10	DATE	06/04/18
		SCALE	NTS