

# Certificate of Accreditation

## Sewage Management Facility

### Sewage Ejection Pump Station

This Certificate of Accreditation is issued by the Secretary of the NSW Ministry of Health pursuant to Section 41(1) Local Government (General) Regulation 2021.

**System:** GRAF SC2000 Pump Station

**Manufacturer:** GRAF Australia Pty Ltd

**Of:** 43b Sparks Road, Henderson, WA, 6166

The GRAF SC2000 Sewage Ejection Pump Station as described in the following schedule, has been accredited as a Sewage Management Facility for use in a single domestic premises in NSW. The Sewage Ejection Pump Station has been independently certified as being manufactured to Australian / New Zealand Standard "AS/NZS1546.1:2008 On-site domestic wastewater treatment units – Part 1: Septic tanks".



**Director, Environmental Health**

For Secretary (Delegation PH335)

Issued: 2 / 8 / 2024

Certificate Number: SEPS022

Expires 31 December 2029


## Accreditation Schedule

*The Certificate of Accreditation applies to the GRAF Australia SC2000 Sewage Ejection Pump Station models in accordance with the attached plan and of 2000 litres capacity.*

*The GRAF Australia SC2000 Sewage Ejection Pump Station consists of:*

- A roto moulded polyethylene pump well and mini or maxi dome and or risers;*
- A trafficable lid authorised by GRAF;*
- A Xylem, Grundfos or DAB submersible pump fitted with start, stop and high-level switches in a single or dual combination either free standing or in guide rails;*
- A flexible PVC discharge hose or polyethylene discharge pipe fitted to a combination anti-syphon/check valve and shut-off valve on the outlet of the submersible pump. The discharge pipe is connected to a 40 mm diameter hose pressure main to the sewer through a boundary connection box located just inside the property;*
- A control panel with an audible and visible alarm.*

MANUALS MUST BE FULLY OBSERVED FOR INSTALLATION AND SET UP.

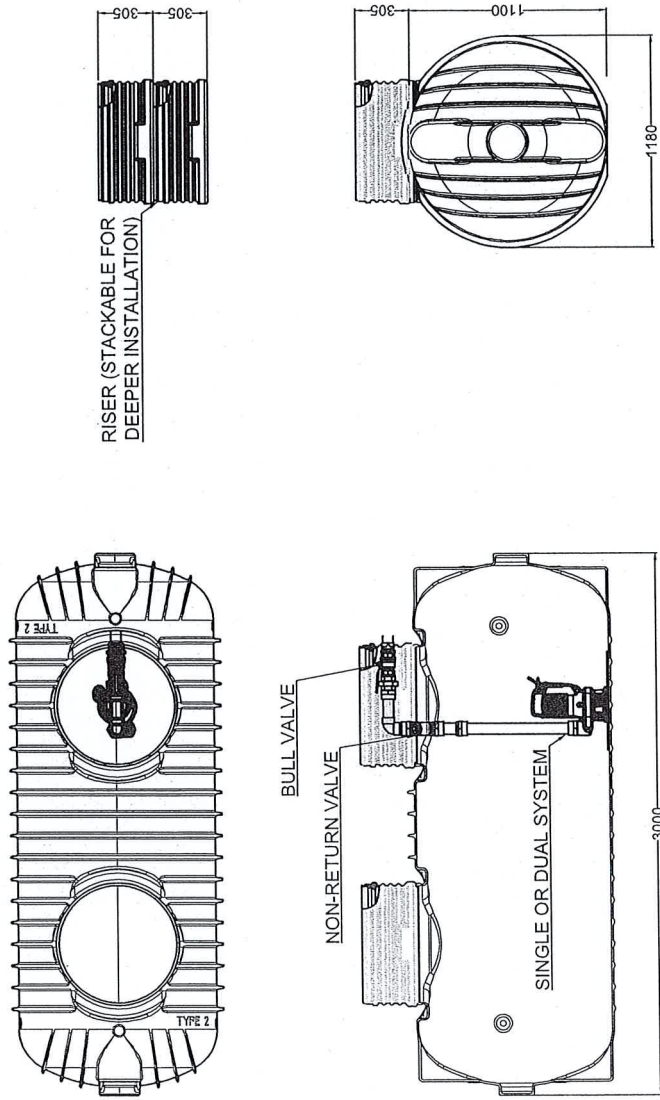

**ACCREDITED**  
2 AUG 2024  
NSW MINISTRY OF HEALTH

article		GRAF Australia SC 2000 pump stations - typical layout		article no.
drawn	ISC	weight	190 kg	GRAF Australia Pty Ltd 43b Sparks Road, Henderson WA 6166 info@grafaustalia.com.au www.grafaustalia.com.au
date	2024.06.11	tolerance	+/- 3%	
		comments	bull valve may be installed in external box instead pump(s) might be automatic or manual	
		scale	1:40	units
				mm

