

Certificate of Accreditation

Sewage Management Facility

Septic Tank / Collection Well

This Certificate of Accreditation is issued by the Secretary of the NSW Ministry of Health pursuant to Section 41(1) Local Government (General) Regulation 2021.

Manufacturer: Wastewater Australia Pty Ltd t/a Garden Master

Of: 5/34 Racecourse Road, Rutherford, NSW, 2320

The Septic Tank / Collection Well as described in the following schedule, have been accredited as Sewage Management Facilities for use in a single domestic premises in NSW. The Septic Tanks and Collection Wells have been independently certified as being manufactured to Australian / New Zealand Standard "AS/NZS1546.1:2008 On-site domestic wastewater treatment units – Part 1: Septic tanks".



Director, Environmental Health

For Secretary (Delegation PH335)

Issued: 24/02/2025




Certificate Number: STCW051

Expires 31 December 2028

Accreditation Schedule

The Certificate of Accreditation applies to the following
Septic Tanks / Collection Wells

Model	Description	Size
Septic Tank	Vertical axis type, cylindrical precast, steel fibre reinforced concrete with lid, access cover, inlet and outlet fittings. Burial depth of the tank lid is restricted to 0 mm	3700 L 6400 L 7600 L
Collection Well	Vertical axis type, cylindrical precast, fibre reinforced concrete, with lid, access cover and inlet fitting. It does not include the internal fittings or partitions Burial depth of the tank lid is restricted to 0 mm	4000 L 6800 L 8000 L

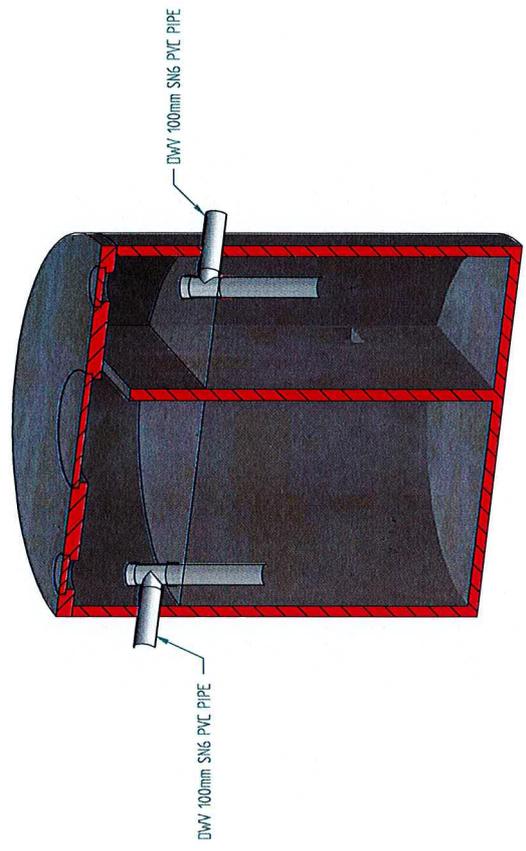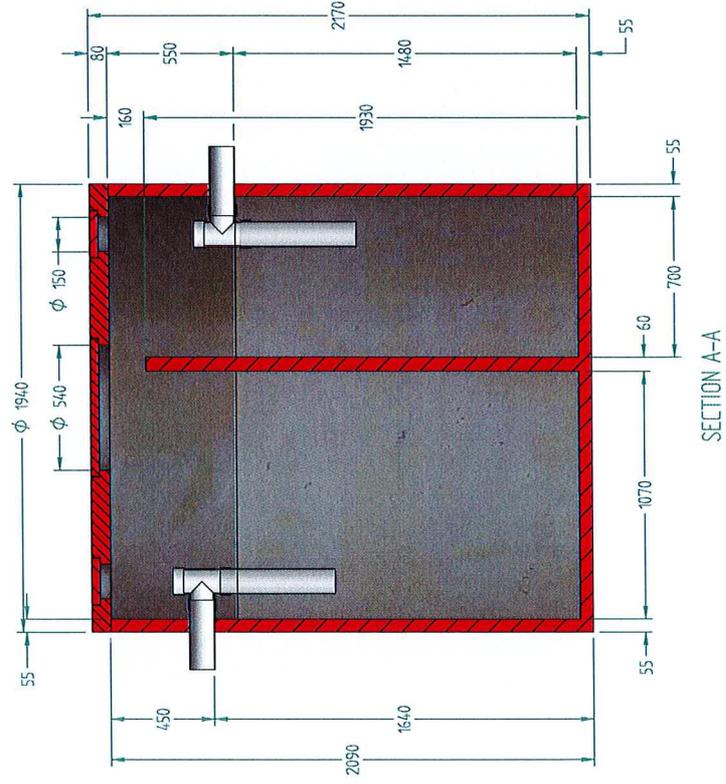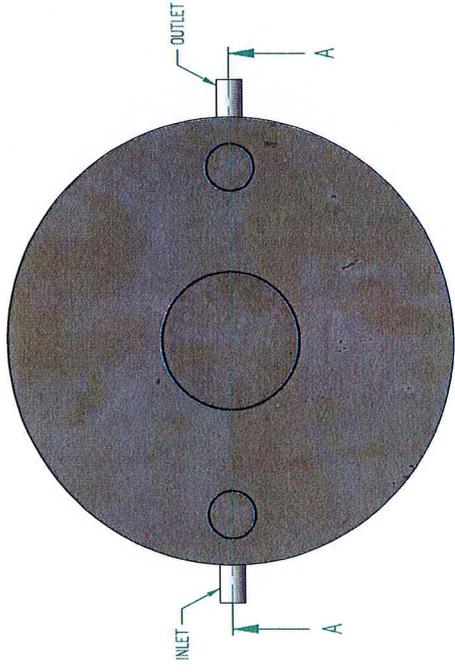


ACCREDITED
24 FEB 2025
NSW MINISTRY OF HEALTH

- NOTES:
1. SEPTIC TANKS TO BE MANUFACTURED AND TESTED IN ACCORDANCE WITH AS/NZS 1546:12008
 2. CONCRETE STRENGTH = 40MPa
 3. CONCRETE TO BE VIBRATED TO ENSURE WELL COMPACTED CONCRETE
 4. TANKS TO BE REINFORCED WITH FIBRE
 5. 4 x 25 TONNE FOOT ANCHORS CAST INTO BASE OF THE TANK 3 x 13 TONNE ANCHORS CAST INTO TANK LIDS

COPYRIGHT <small>THIS DOCUMENT IS THE PROPERTY OF WASTEWATER AUSTRALIA. IT IS TO BE USED ONLY FOR THE PROJECT AND SITE SPECIFICALLY IDENTIFIED IN THE TITLE. IT IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, WITHOUT THE WRITTEN PERMISSION OF WASTEWATER AUSTRALIA.</small>	DATE PLOTTED: 24/09/2024 ALL DIMENSIONS = mm DRAWING LAST MODIFIED BY: Peter McKeay	PROJECT: - TITLE: 3700 SEPTIC TANK PART #	SHEET SIZE: A3 VERSION: V1 SHEET NO: 1/1
	PROJECT: - TITLE: 3700 SEPTIC TANK PART #		SHEET SIZE: A3 VERSION: V1 SHEET NO: 1/1

DATE	23/09/2024	FIRST ISSUE
BY		REV

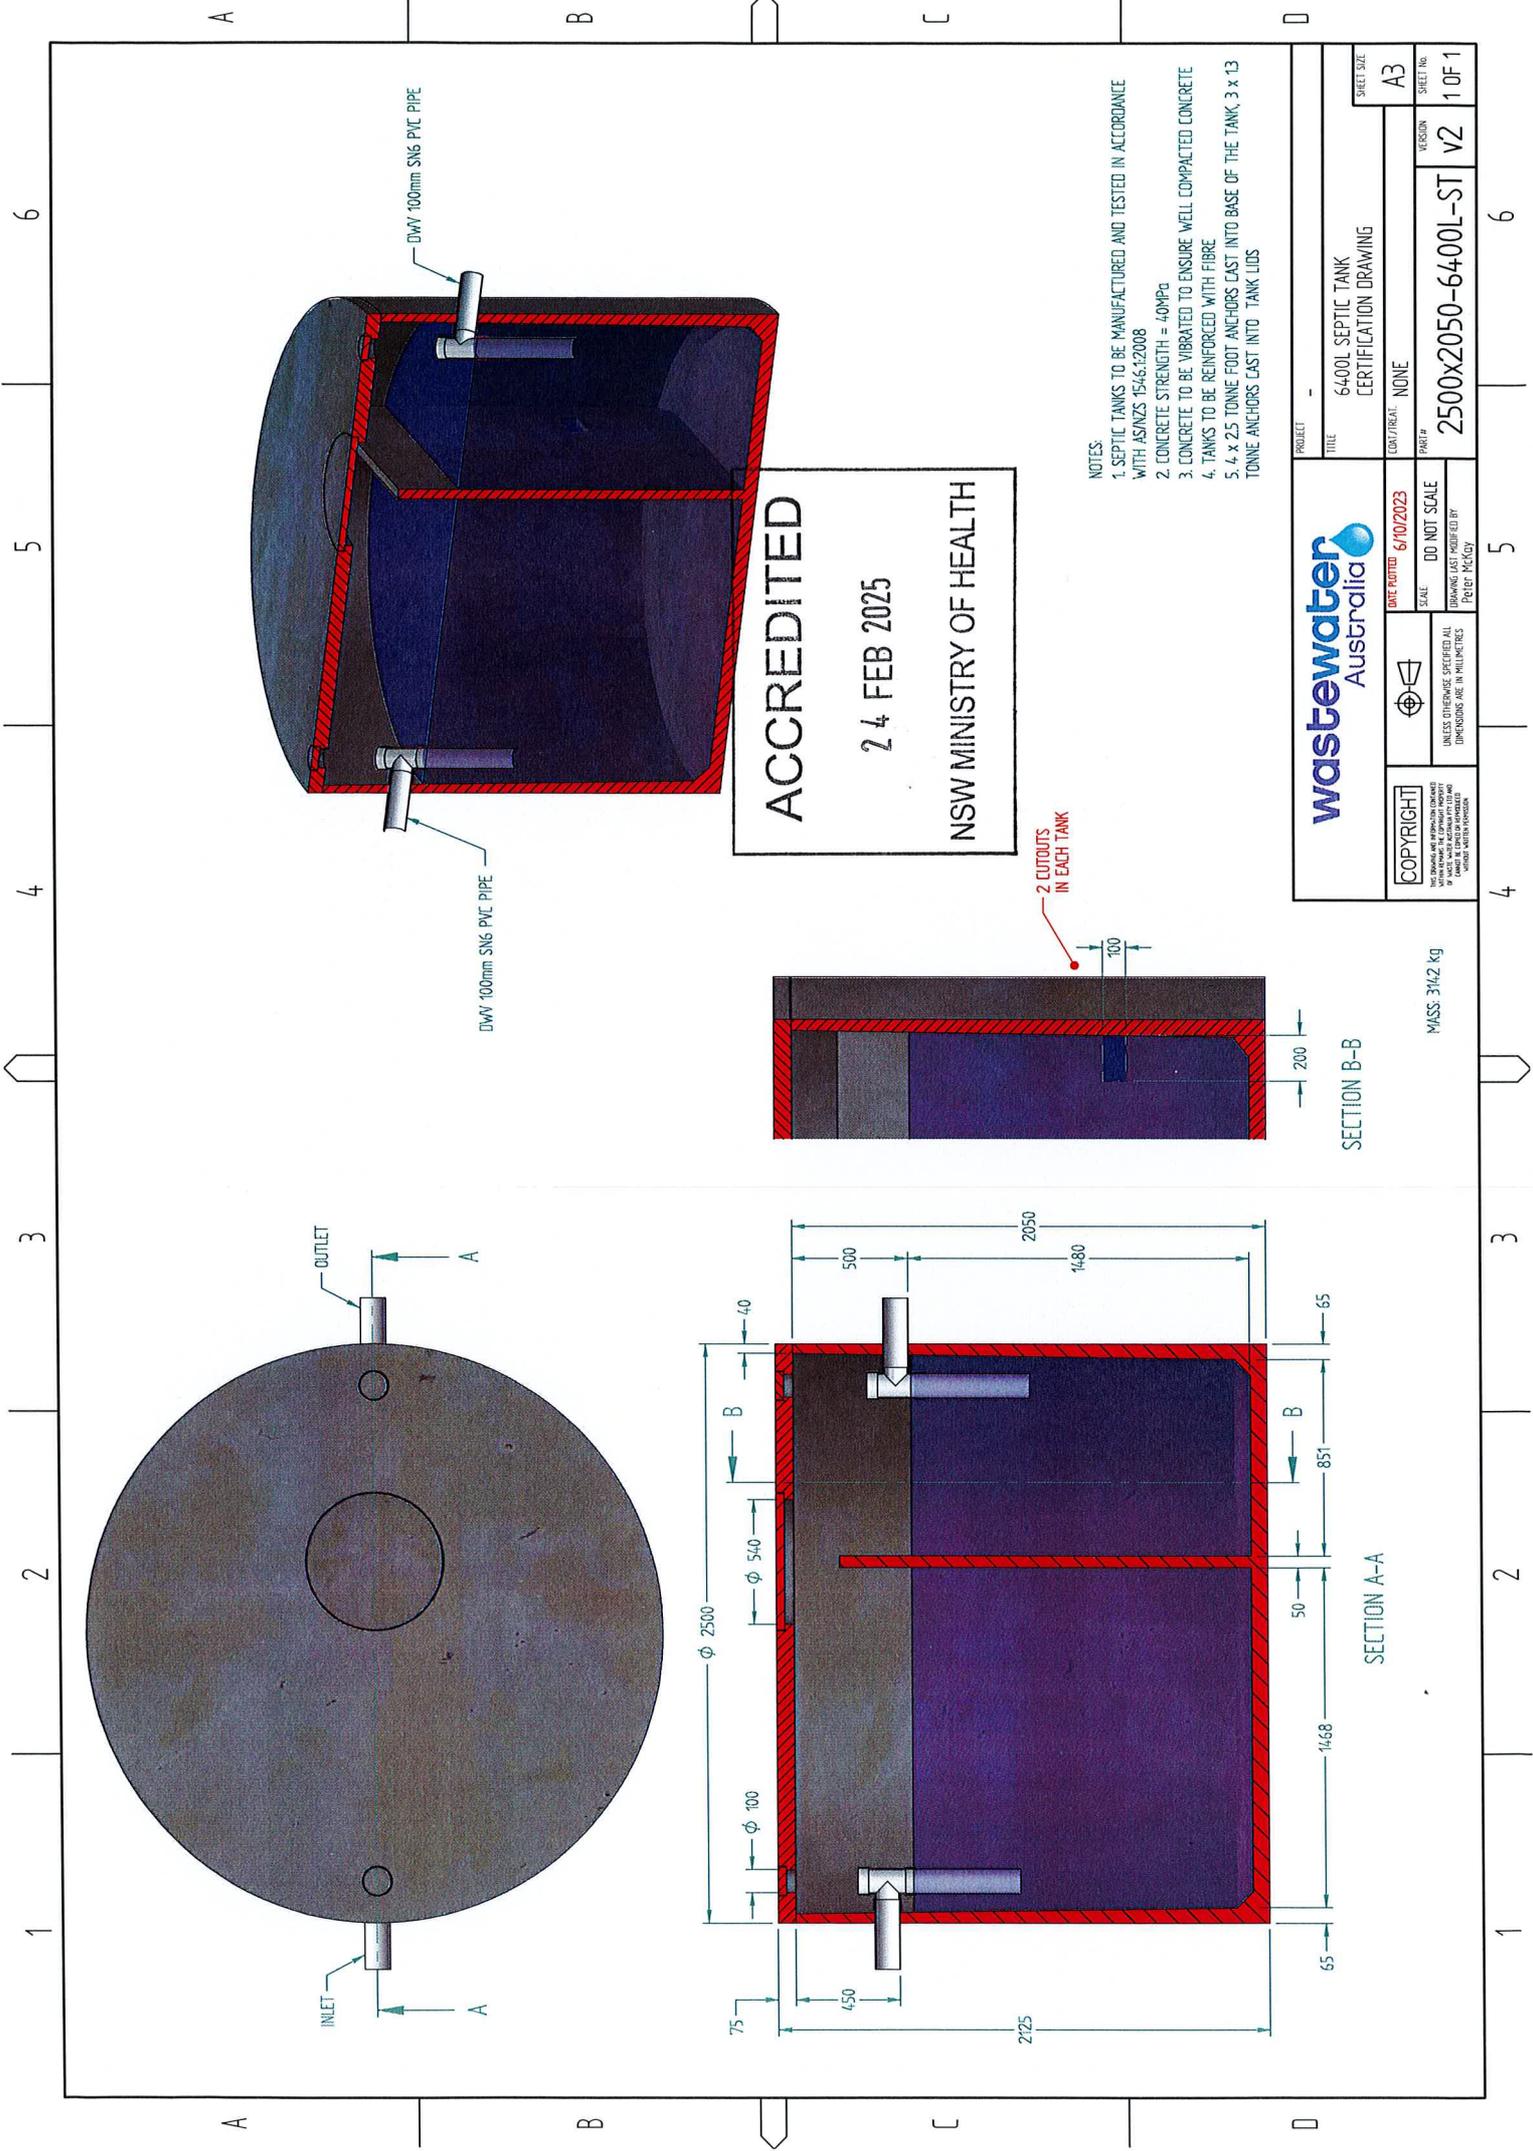

- NOTES:
1. SEPTIC TANKS TO BE MANUFACTURED AND TESTED IN ACCORDANCE WITH AS/NZS 1546.1:2008
 2. CONCRETE STRENGTH = 40MPa
 3. CONCRETE TO BE VIBRATED TO ENSURE WELL COMPACTED CONCRETE
 4. TANKS TO BE REINFORCED WITH FIBRE
 5. 4 x 25 TONNE FOOT ANCHORS CAST INTO BASE OF THE TANK, 3 x 13 TONNE ANCHORS CAST INTO TANK LIDS

ACCREDITED
 24 FEB 2025
 NSW MINISTRY OF HEALTH


wastewater Australia		DATE PUBLISHED: 6/10/2023	SCALE: DO NOT SCALE	VERSION: v2
PROJECT: -		CAD/TREAT: NONE	FORMING CASE NUMBER BY: PERBET MCGILROY	SHEET NO: 1 OF 1
TITLE: 6400L SEPTIC TANK CERTIFICATION DRAWING		PAR# 2500X2050-6400L-ST		
SHEET SIZE: A3				

COPYRIGHT
 THIS DRAWING AND APPROXIMATE DIMENSIONS ARE NOT TO BE USED FOR CONSTRUCTION OF ANY OTHER TANKS WITHOUT THE WRITTEN PERMISSION OF WASTEWATER AUSTRALIA




SECTION B-B

SECTION A-A

MASS: 3142 kg

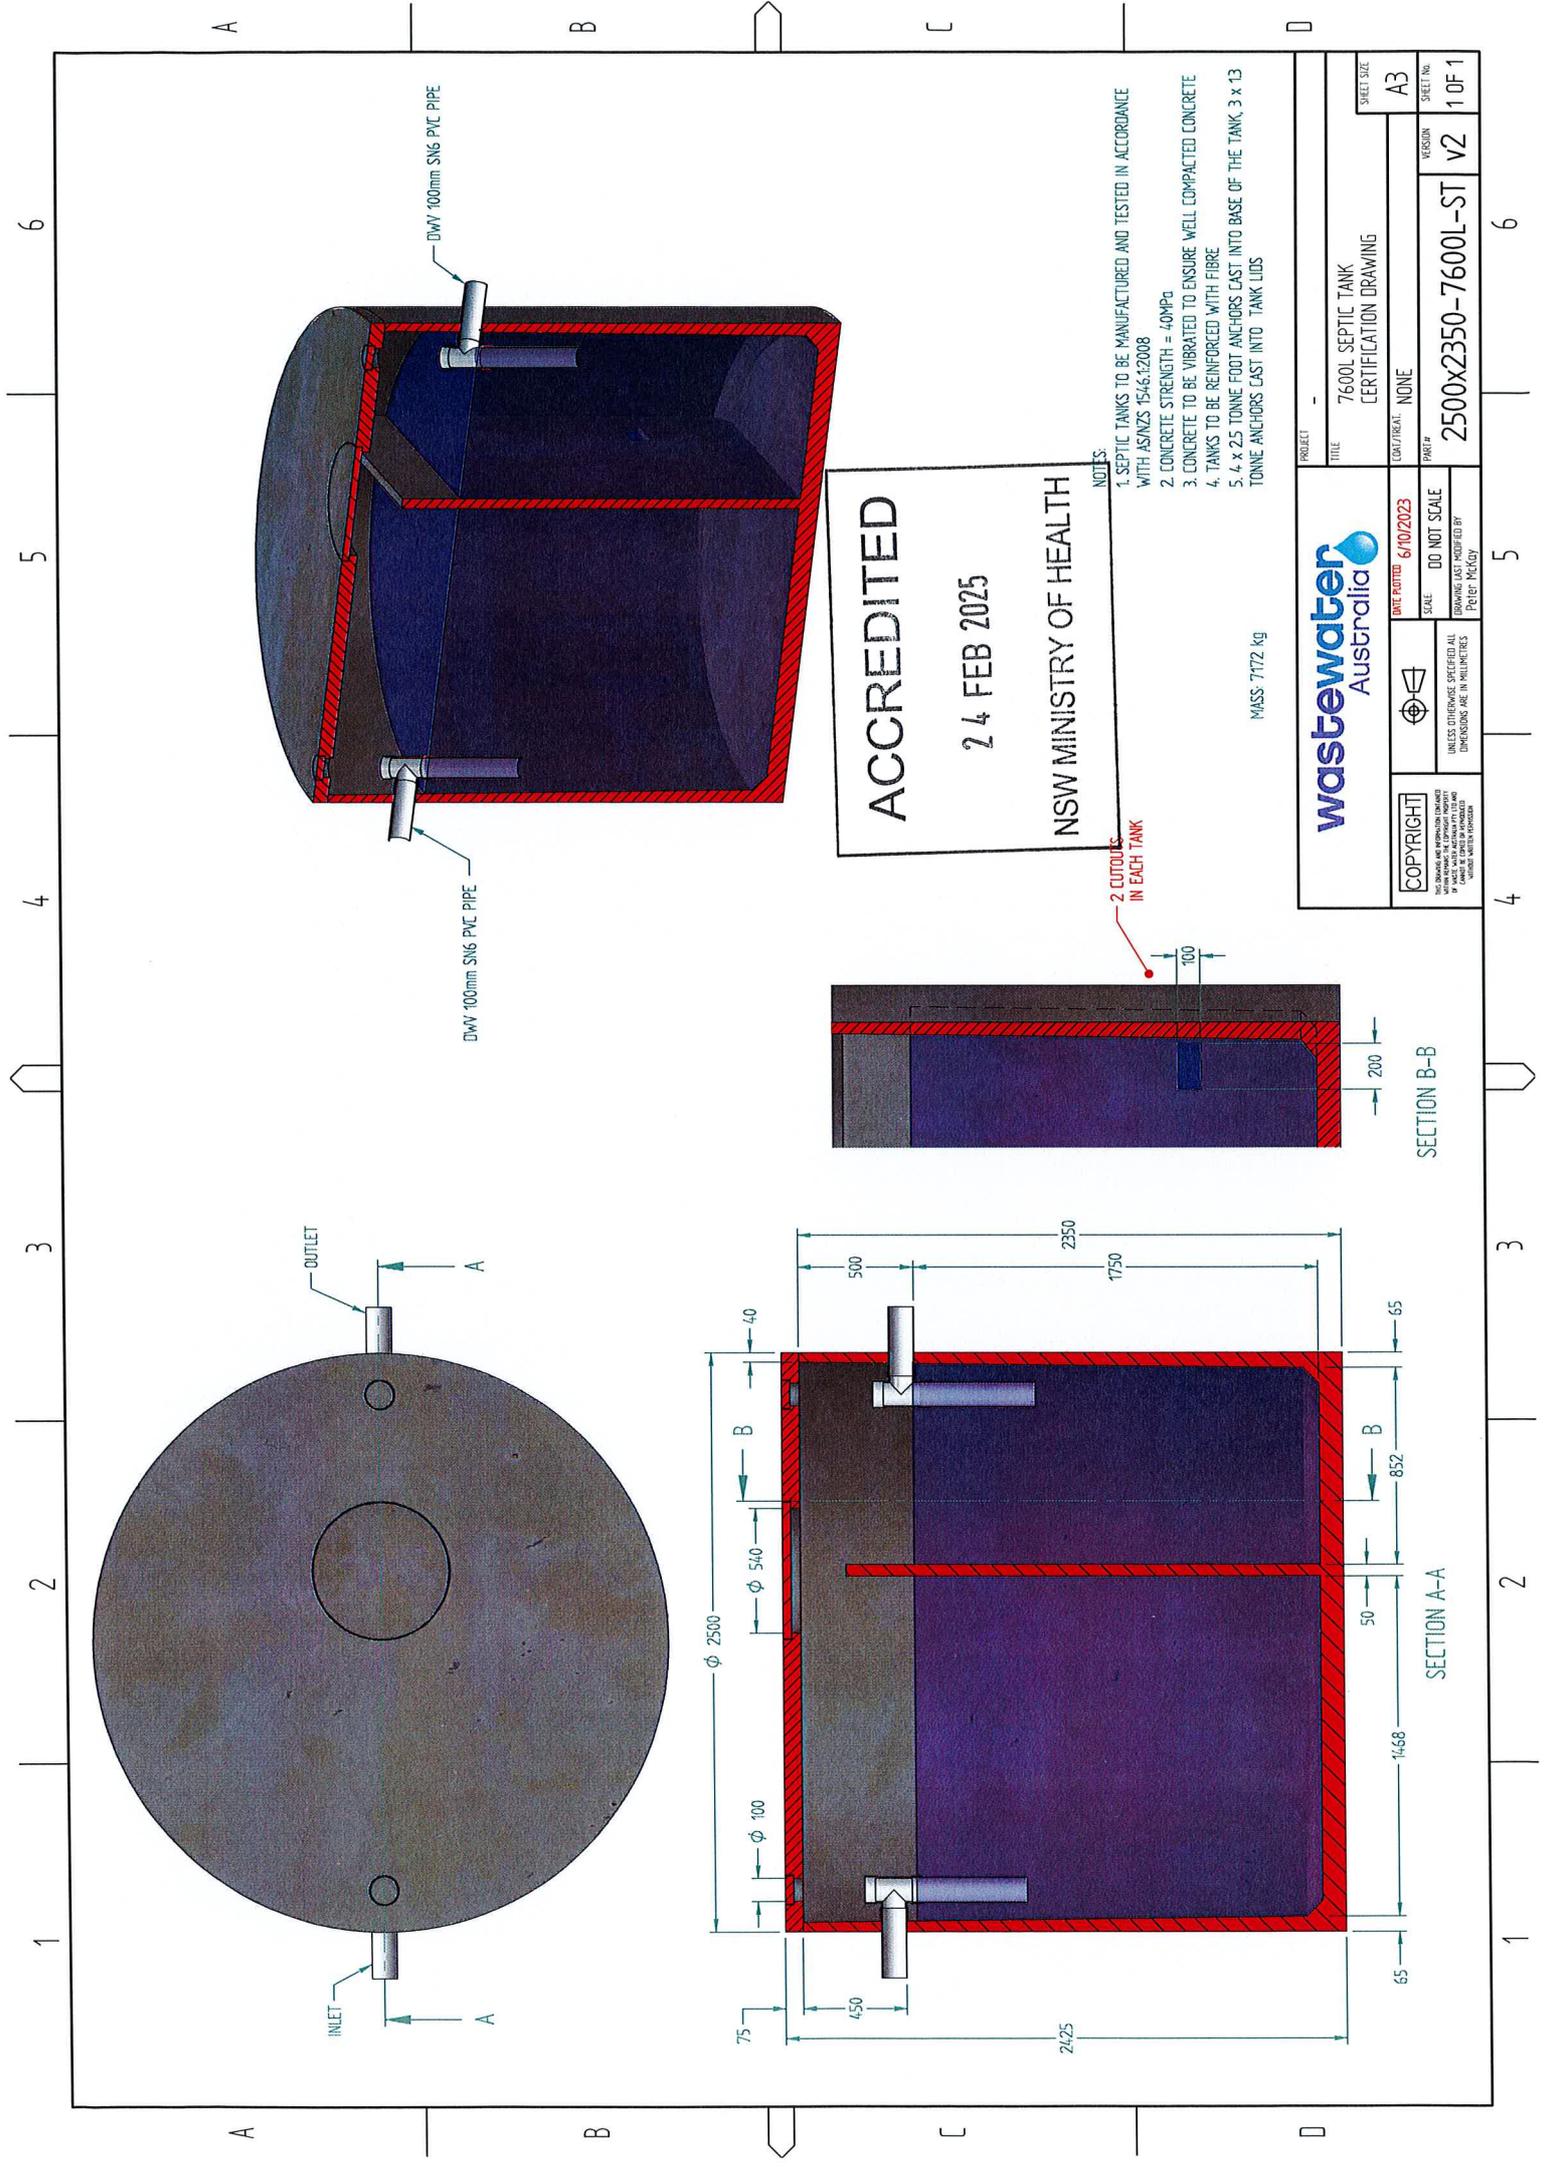

PROJECT		-	
TITLE		7600L SEPTIC TANK CERTIFICATION DRAWING	
COM/ITERA		NONE	
PART#		2500X2350-7600L-ST	
VERSION		V2	
SHEET SIZE		A3	
SHEET NO.		1 OF 1	
DATE EDITED		6/10/2023	
SCALE		DO NOT SCALE	
DRAWN LAST MODIFIED BY		Peter McKelvey	
UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN MILLIMETERS			
COPYRIGHT		THIS DRAWING IS PROPRIETARY (UNLESS OTHERWISE STATED) AND IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, WITHOUT THE WRITTEN PERMISSION OF WASTEWATER AUSTRALIA	
Wastewater Australia			

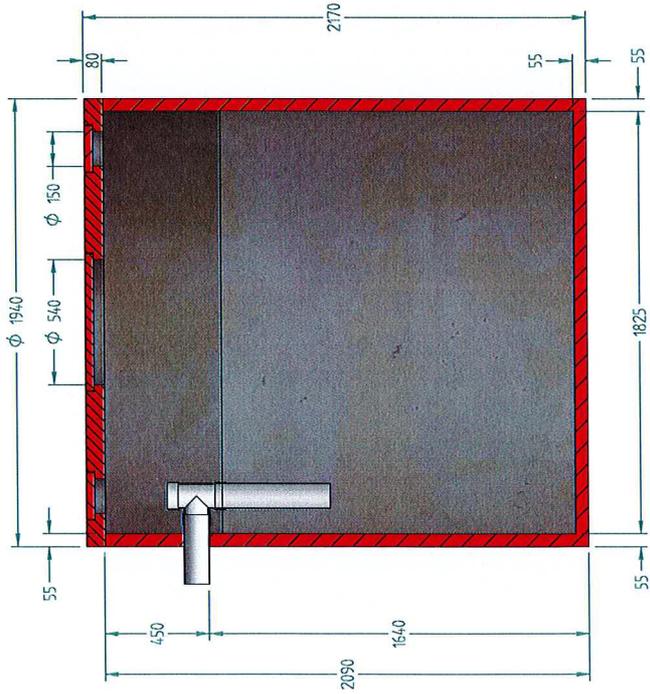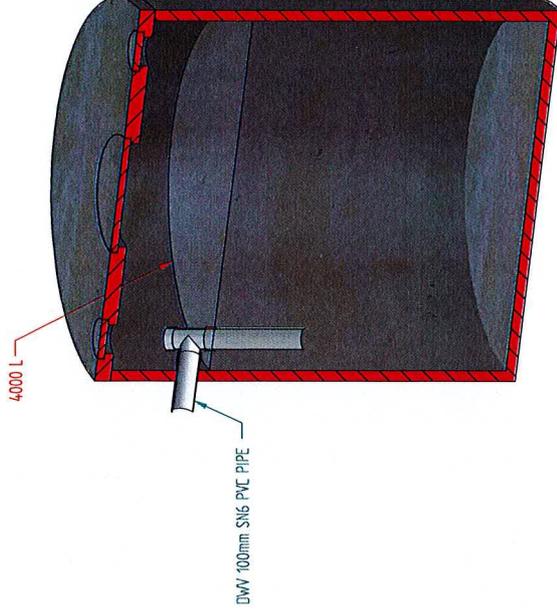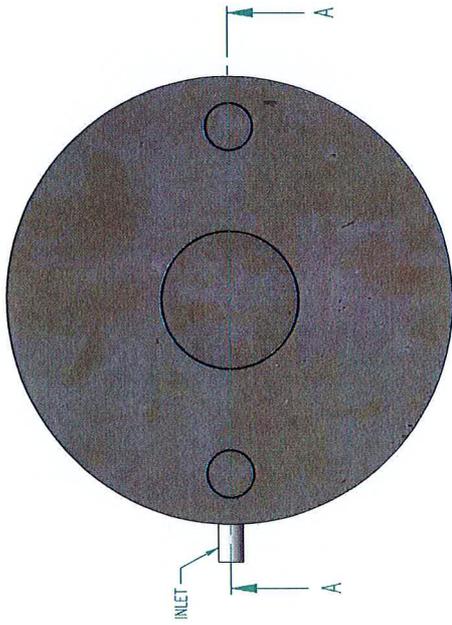


ACCREDITED
24 FEB 2025
NSW MINISTRY OF HEALTH

- NOTES**
1. SEPTIC TANKS TO BE MANUFACTURED AND TESTED IN ACCORDANCE WITH AS/NZS 1546:12008
 2. CONCRETE STRENGTH = 40MPa
 3. CONCRETE TO BE VIBRATED TO ENSURE WELL COMPACTED CONCRETE
 4. TANKS TO BE REINFORCED WITH FIBRE
 5. 4 x 2.5 TONNE FOOT ANCHORS CAST INTO BASE OF THE TANK 3 x 13 TONNE ANCHORS CAST INTO TANK LIDS

COPYRIGHT <small>THIS DOCUMENT IS THE PROPERTY OF WASTEWATER AUSTRALIA. IT IS TO BE USED ONLY FOR THE PROJECT AND SITE SPECIFICALLY IDENTIFIED.</small>	PROJECT: - TITLE: 4000L COLLECTION WELL PART: -	SHEET SIZE: A3
	DATE PUBLISHED: 10/02/2025 ALL DIMENSIONS = mm DRAWING LAST MODIFIED BY: Peter McKay	VERSION: V1

DATE: 10/02/2025 BY: - FIRST ISSUE	DATE: - BY: - VERSION DETAIL	UP: - REV: -
--	------------------------------------	-----------------

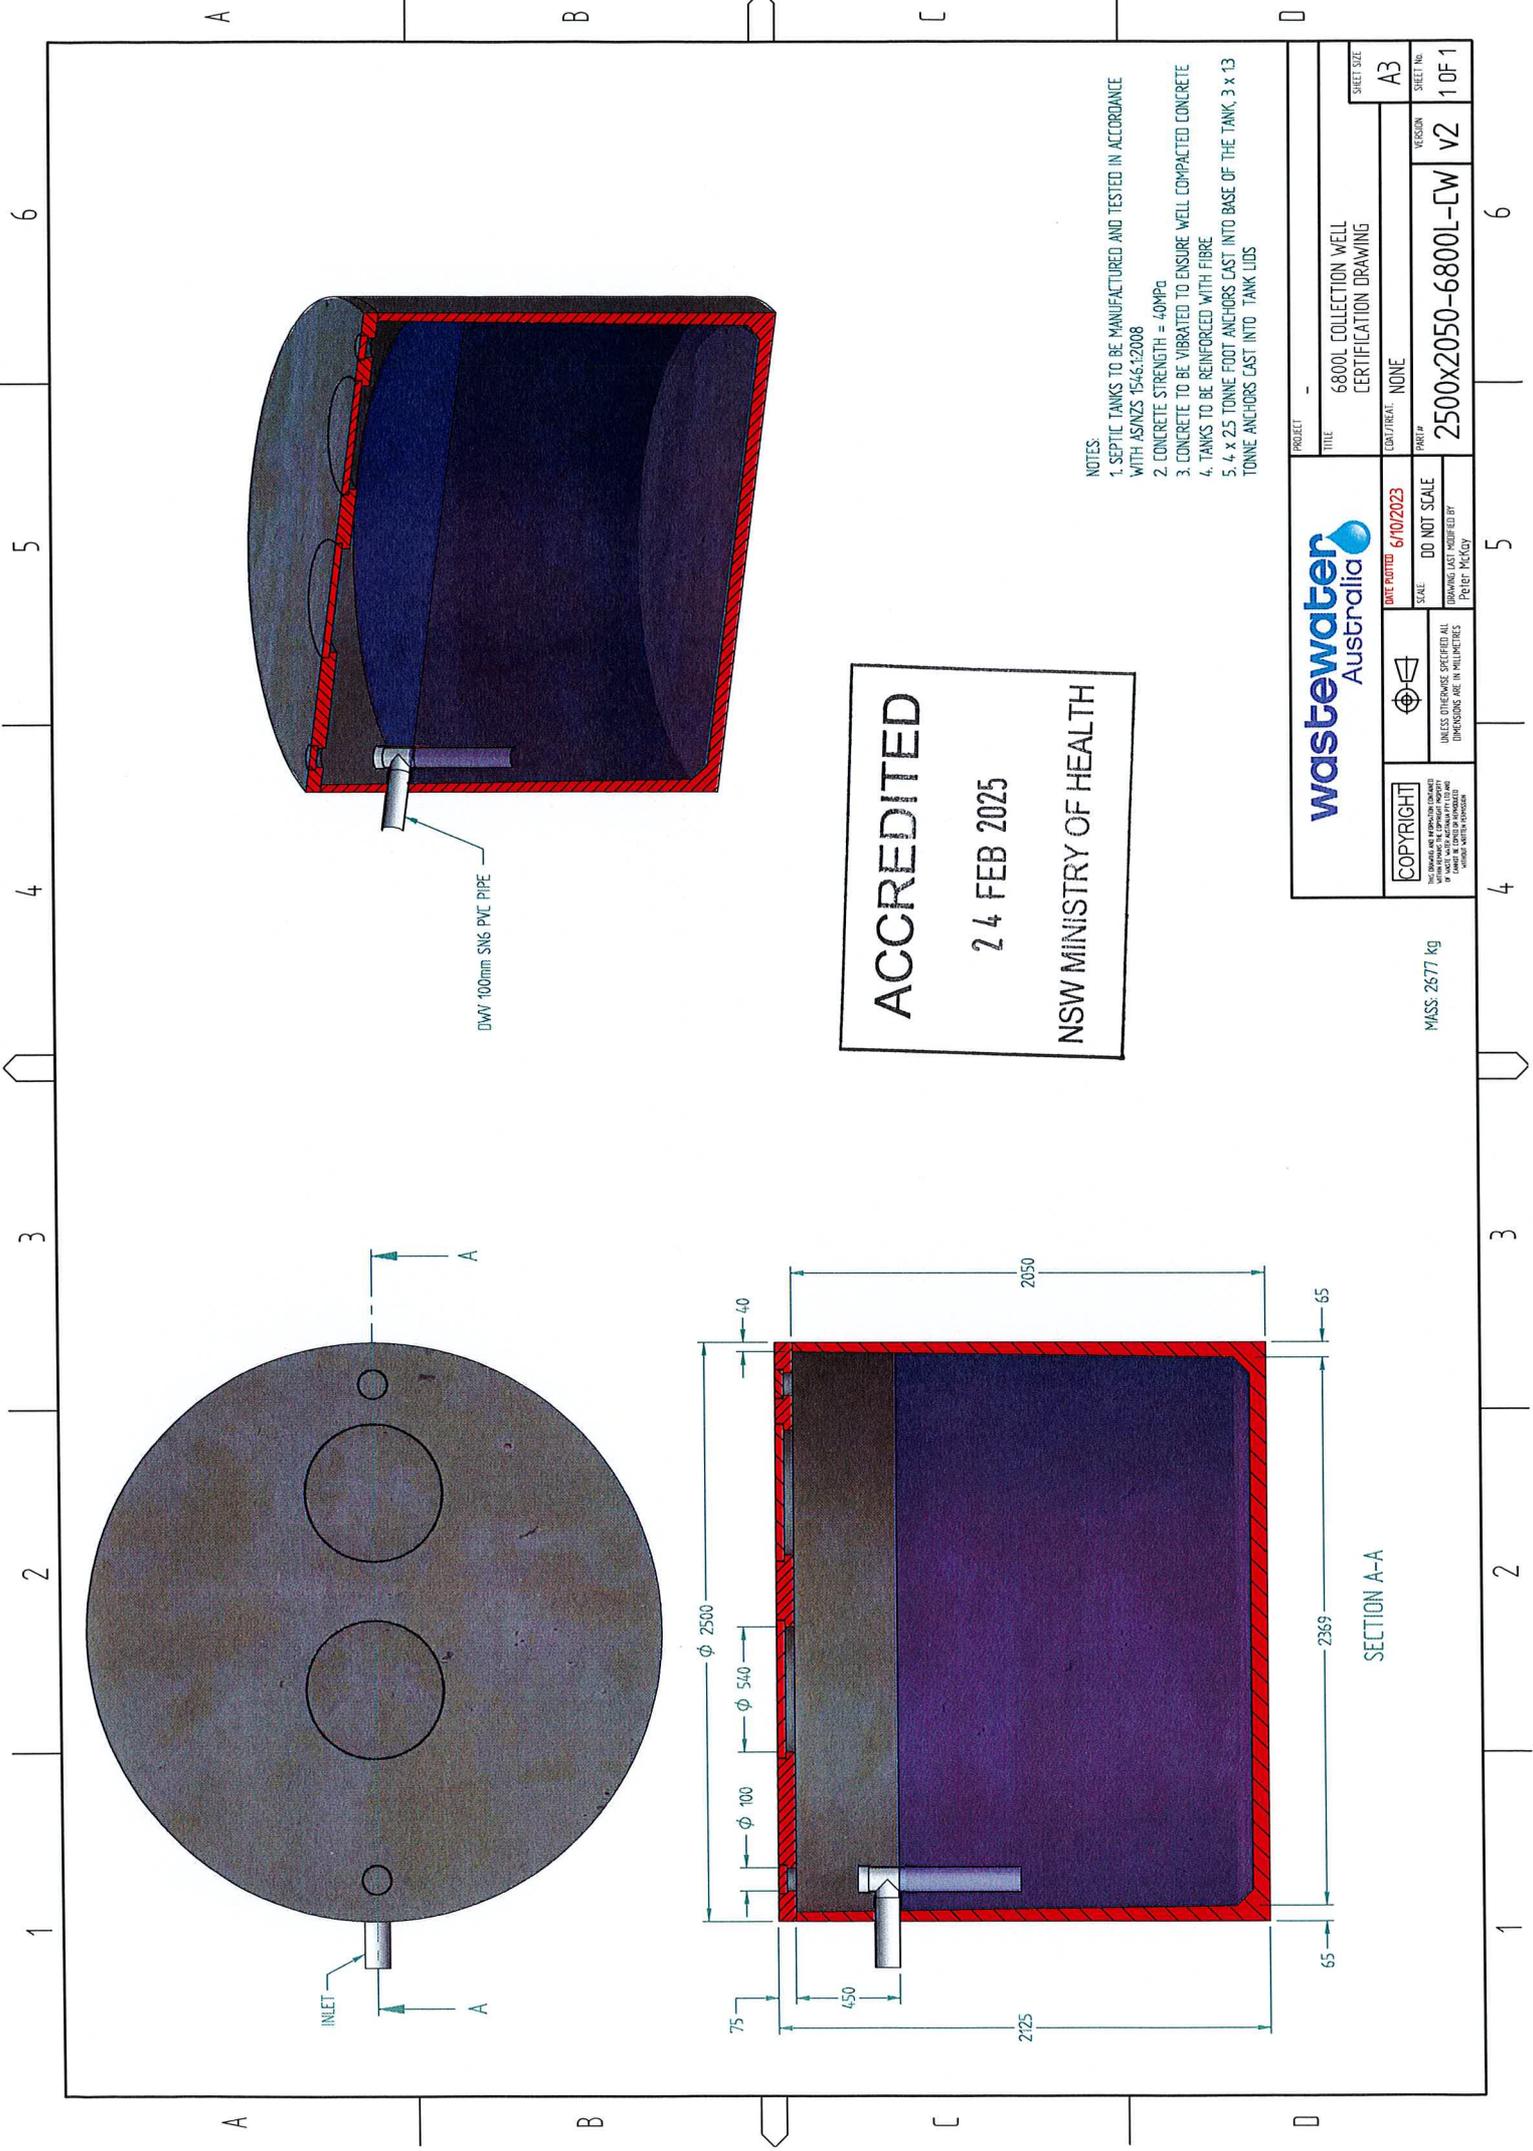




- NOTES:
1. SEPTIC TANKS TO BE MANUFACTURED AND TESTED IN ACCORDANCE WITH AS/NZS 1546.1:2008
 2. CONCRETE STRENGTH = 40MPa
 3. CONCRETE TO BE VIBRATED TO ENSURE WELL COMPACTED CONCRETE
 4. TANKS TO BE REINFORCED WITH FIBRE
 5. 4 x 25 TONNE FOOT ANCHORS CAST INTO BASE OF THE TANK, 3 x 13 TONNE ANCHORS CAST INTO TANK LIDS

ACCREDITED
24 FEB 2025
NSW MINISTRY OF HEALTH

wastewater Australia		DATE EDITED 6/10/2023	CONTRACTOR NONE	SHEET SIZE A3
PROJECT -		SCALE DO NOT SCALE	REVISION V2	SHEET NO. 1 OF 1
TITLE 6800L COLLECTION WELL CERTIFICATION DRAWING		UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN MILLIMETRES	PROJECT 2500X2050-6800L-CW	
COPYRIGHT		UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN MILLIMETRES	DESIGNED BY Peter McKee	
MASS 2677 kg				

1 2 3 4 5 6

A B C D

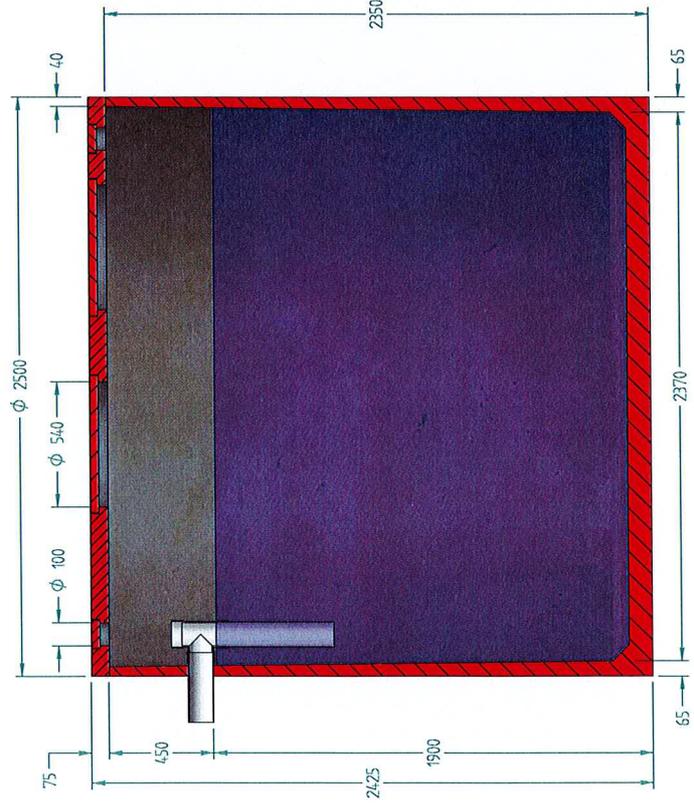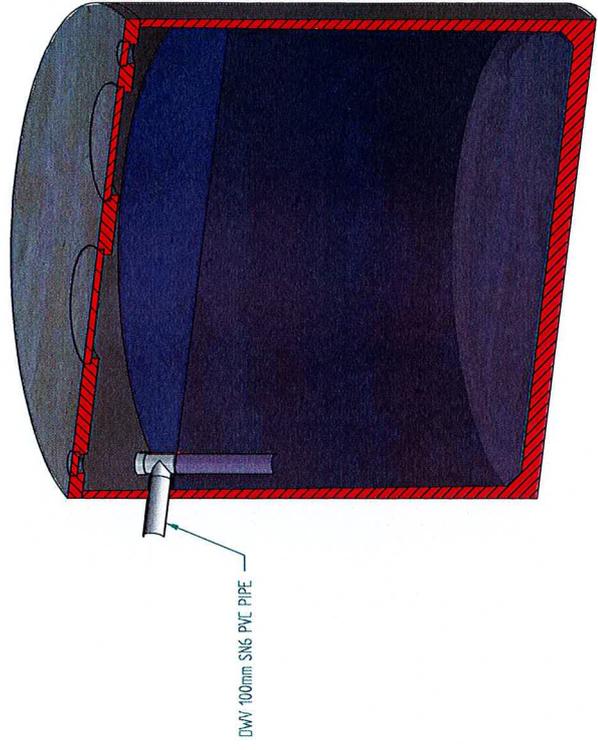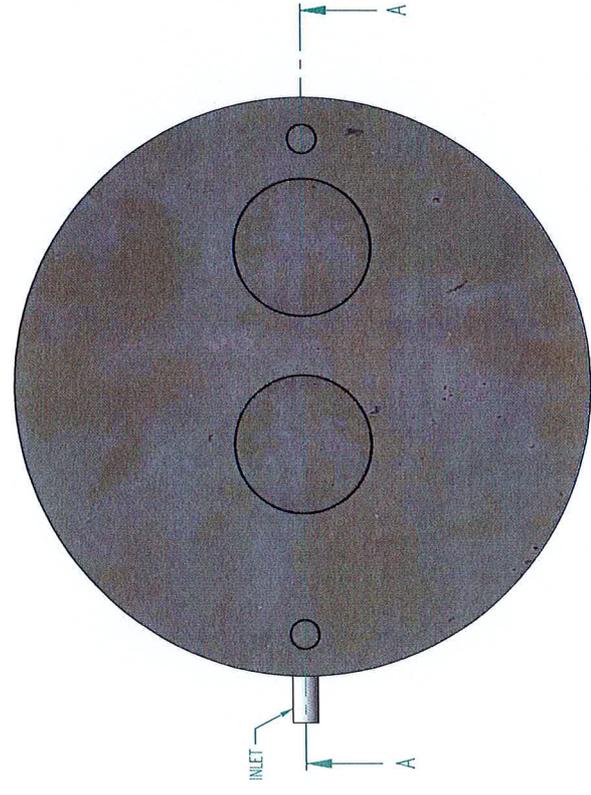

ACCREDITED
24 FEB 2025
NSW MINISTRY OF HEALTH

- NOTES:
1. SEPTIC TANKS TO BE MANUFACTURED AND TESTED IN ACCORDANCE WITH AS/NZS 1546.1:2008
 2. CONCRETE STRENGTH = 40MPa
 3. CONCRETE TO BE VIBRATED TO ENSURE WELL COMPACTED CONCRETE
 4. TANKS TO BE REINFORCED WITH FIBRE
 5. 4 x 2.5 TONNE FOOT ANCHORS CAST INTO BASE OF THE TANK, 3 x 13 TONNE ANCHORS CAST INTO TANK LIDS

wastewater Ausepalia		DATE PUBLISHED: 6/10/2023	CONTRACT: NONE	SHEET SIZE: A3
COPYRIGHT THIS DRAWING IS PROPRIETARY AND NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS WITHOUT PERMISSION.		SCALE: DO NOT SCALE DIMENSIONS LISTED REFER TO PRIOR VERSIONS	REVISION: V2	SHEET NO: 1 OF 1
PROJECT: -		TITLE: 8000L COLLECTION WELL CERTIFICATION DRAWING		
PART #		PART #		
2500x2350-8000L-CW		2500x2350-8000L-CW		
MASS: 4061 kg				

1 2 3 4 5 6