



Certificate of Accreditation

Sewage Management Facility

Septic Tanks & Collection Wells

This Certificate of Accreditation is issued by the Secretary of the NSW Ministry of Health pursuant to section 41(1) of the Local Government (General) Regulation 2021.

Manufacturer: *Wastewater Australia Pty Ltd*
t/a Garden Master

Of: *5/34 Racecourse Road, Rutherford, NSW, 2320*

The Septic Tanks and Collection Wells as described in the following Schedule have been accredited as sewage management facilities for use in single domestic premises in NSW.

*A/Director, Environmental Health
for Secretary (delegation PH335)*

Issued: *12 / Jan / 2024*

Certificate No: *STCW051*





Expires: *31 December 2028*



Accreditation Schedule

*The Certificate of Accreditation applies to the following
Septic Tanks and Collection Wells*





Model	Description	Size
Septic Tank	Vertical axis type, cylindrical precast fibre reinforced concrete, with lid, access cover, inlet, and outlet fittings.	6400 L 7600 L
Collection Well	Vertical axis type, cylindrical precast fibre reinforced concrete, with lid, access cover and inlet fitting. Certification applies only to the construction of the tank, lid and access cover. It does not include internal fittings or partitions.	6800 L 8000 L

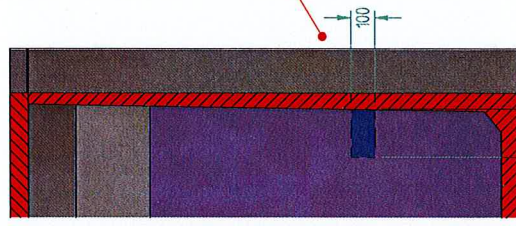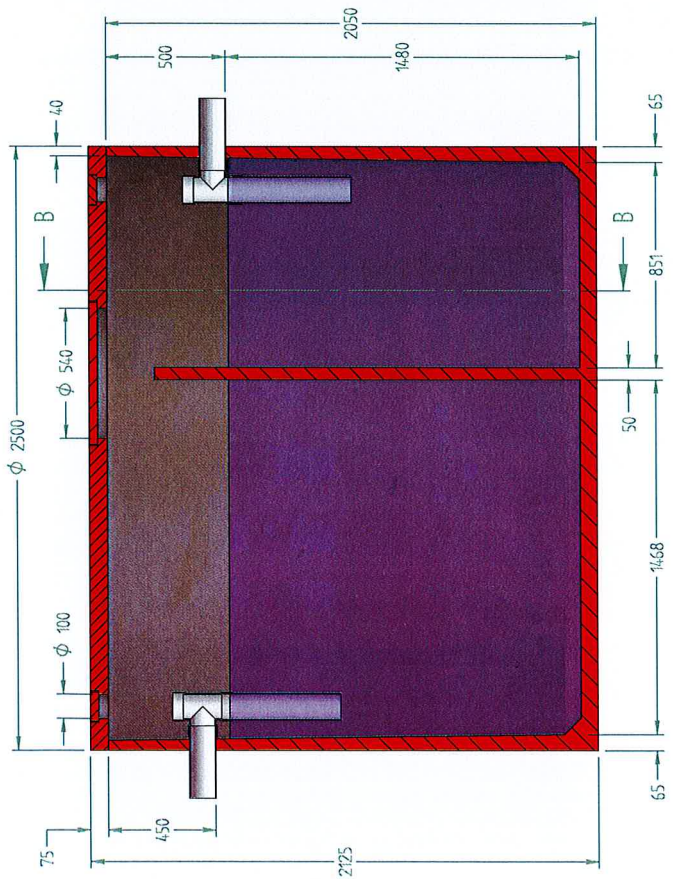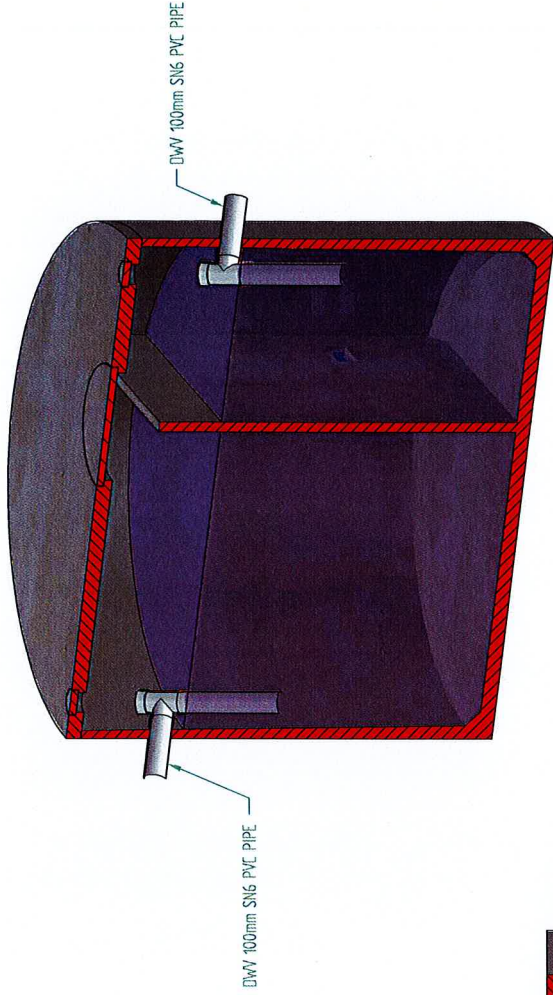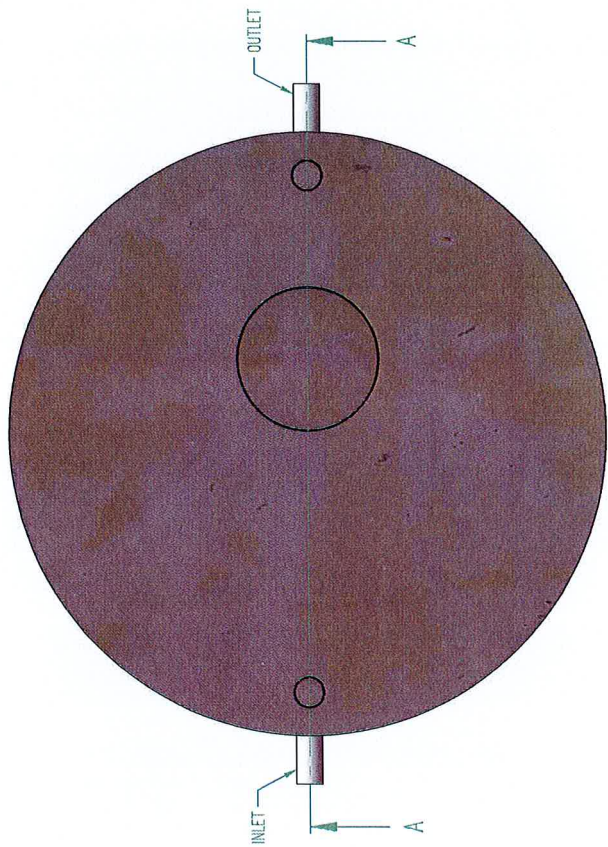

- NOTES
1. SEPTIC TANKS TO BE MANUFACTURED AND TESTED IN ACCORDANCE WITH AS/NZS 1546:2008
 2. CONCRETE STRENGTH = 40MPa
 3. CONCRETE TO BE VIBRATED TO ENSURE WELL COMPACTED CONCRETE
 4. TANKS TO BE REINFORCED WITH FIBRE
 5. 4 x 2.5 TONNE FOOT ANCHORS CAST INTO BASE OF THE TANK, 3 x 13 TONNE ANCHORS CAST INTO TANK LIDS

wastewater Australia		DATE PLOTTED: 6/10/2023	SCALE: DO NOT SCALE	VERSION: v2	SHEET No: 1 OF 1
PROJECT: -		TITLE: 6400L SEPTIC TANK CERTIFICATION DRAWING	CONTRACT: NONE	PART#: 2500X2050-6400L-ST	
COPYRIGHT: THIS DRAWING AND INFORMATION CONTAINED HEREIN IS THE PROPERTY OF WASTE WATER AUSTRALIA AND IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, WITHOUT PERMISSION FROM WASTE WATER AUSTRALIA.		DRAWING LAST MODIFIED BY: PETER McLEOD			

MASS: 3142 kg

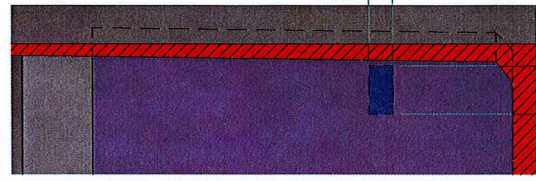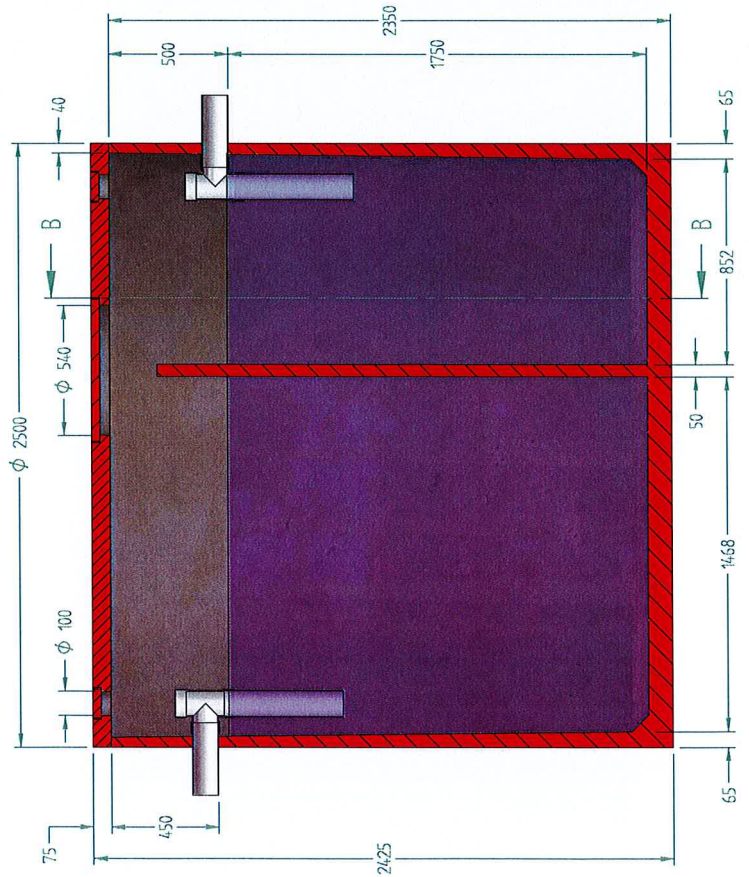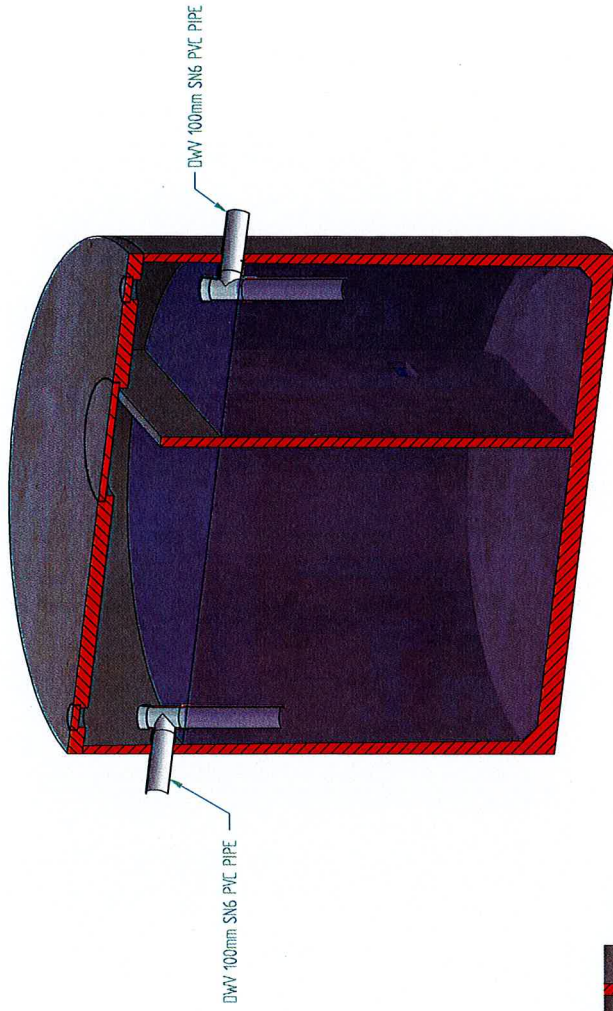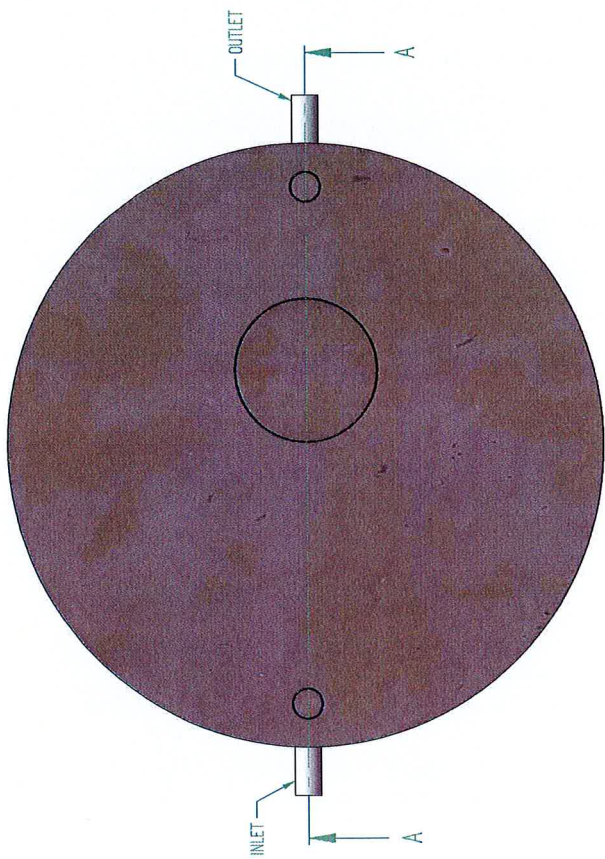

- NOTES:
1. SEPTIC TANKS TO BE MANUFACTURED AND TESTED IN ACCORDANCE WITH AS/NZS 1546:12008
 2. CONCRETE STRENGTH = 40MPa
 3. CONCRETE TO BE VIBRATED TO ENSURE WELL COMPACTED CONCRETE
 4. TANKS TO BE REINFORCED WITH FIBRE
 5. 4 x 2.5 TONNE FOOT ANCHORS CAST INTO BASE OF THE TANK. 3 x 13 TONNE ANCHORS CAST INTO TANK LIDS



MASS 7172 kg

2 CUTOUTS
IN EACH TANK


		DATE PLOTTED 6/10/2023 SCALE DO NOT SCALE DRAWING LAST MODIFIED BY PERCY MCKEY	SHEET SIZE A3 SHEET NO. 1 OF 1
PROJECT - TITLE 7600L SEPTIC TANK CERTIFICATION DRAWING	DATA/TREAT. NONE PART # 2500X2350-7600L-ST VERSION V2	UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN MILLIMETRES UNLESS NOTED OTHERWISE	COPYRIGHT THIS DRAWING IS UNREGISTERED PROPERTY OF WASTEWATER AUSTRALIA. IT IS TO BE USED AS A GUIDE ONLY AND NOT TO BE REPRODUCED OR COPIED IN ANY MANNER WITHOUT WRITTEN PERMISSION.

SECTION B-B

SECTION A-A

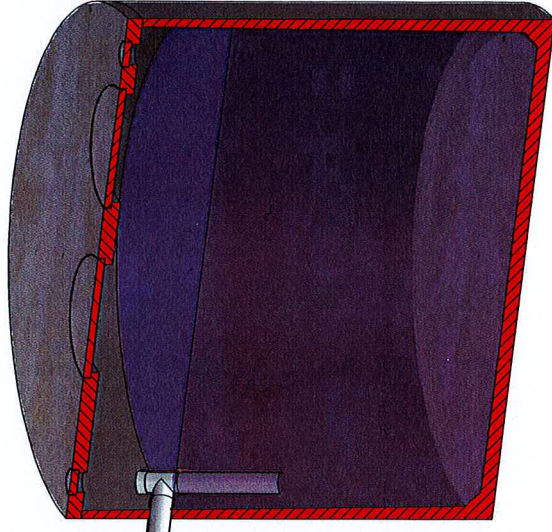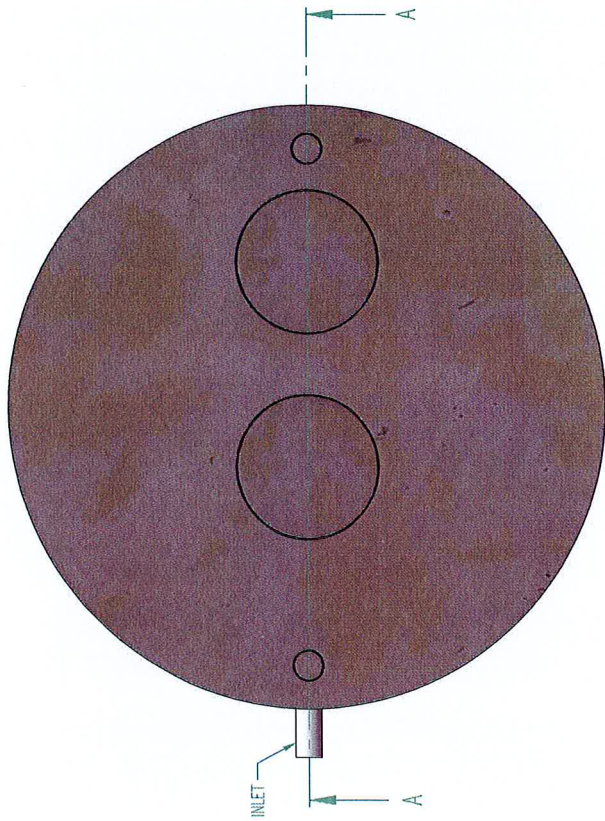



DWV 100mm SNG PVC PIPE

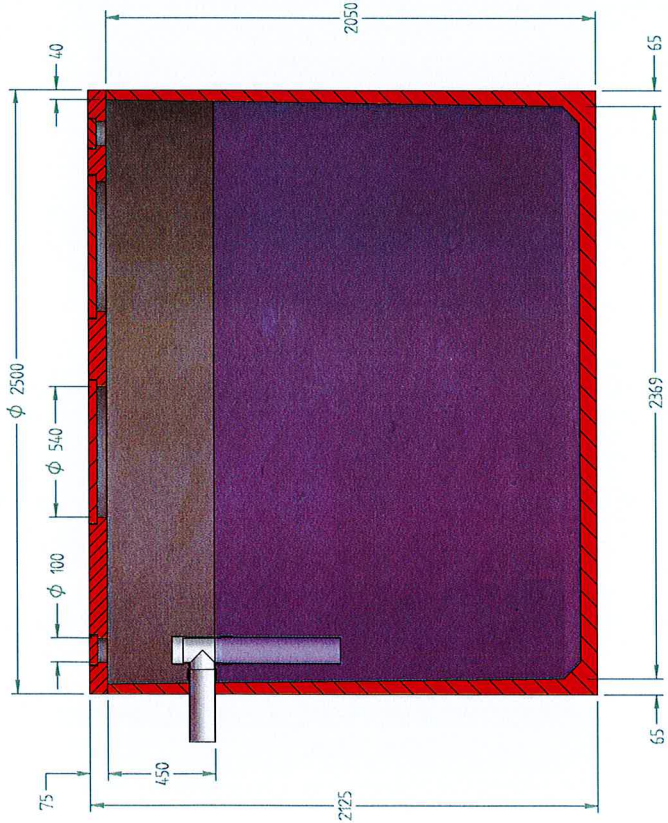


SECTION A-A

- NOTES:
1. SEPTIC TANKS TO BE MANUFACTURED AND TESTED IN ACCORDANCE WITH AS/NZS 1546:12008
 2. CONCRETE STRENGTH = 40MPa
 3. CONCRETE TO BE VIBRATED TO ENSURE WELL COMPACTED CONCRETE
 4. TANKS TO BE REINFORCED WITH FIBRE
 5. 4 x 2.5 TONNE FOOT ANCHORS CAST INTO BASE OF THE TANK, 3 x 13 TONNE ANCHORS CAST INTO TANK LIDS

		PROJECT - TITLE 6800L COLLECTION WELL CERTIFICATION DRAWING	SHEET SIZE A3
DATE PLOTTED 6/10/2023 SCALE DO NOT SCALE DRAWING LAST MODIFIED BY Peter McKoy	CON/TREAT. NONE PART # 2500X2050-6800L-CW	VERSION v2	SHEET NO. 1 OF 1
COPYRIGHT <small>THIS DRAWING AND INFORMATION CONTAINED HEREIN IS THE PROPERTY OF WASTE WATER AUSTRALIA AND IS TO BE USED ONLY FOR THE PROJECT AND SITE SPECIFICALLY IDENTIFIED. IT IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, WITHOUT PERMISSION.</small>		MASS 26777 kg	

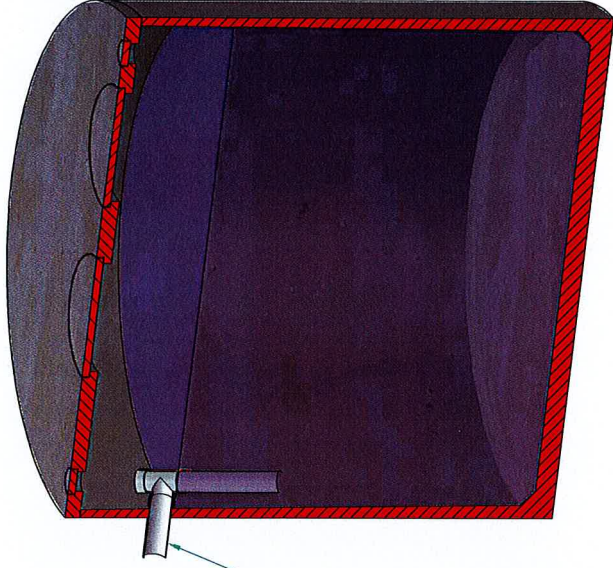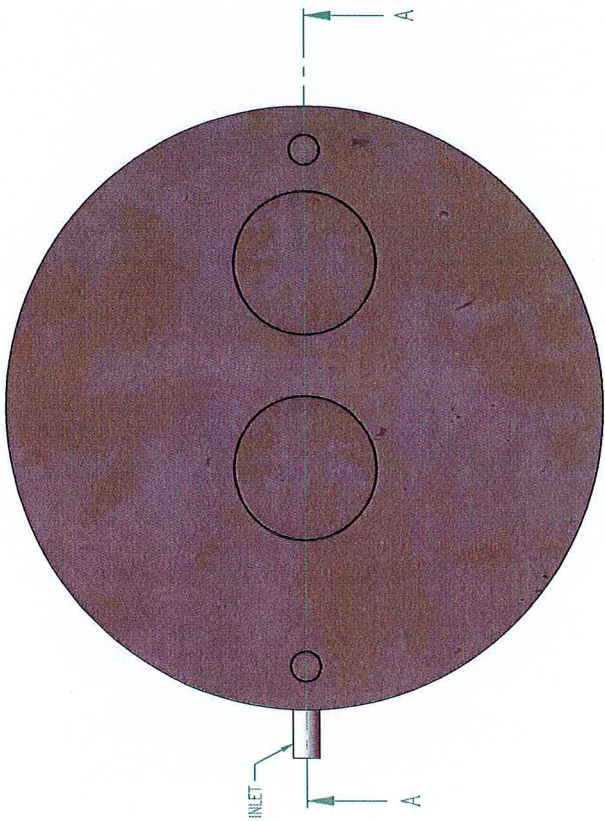

ØW 100mm SNG PVC PIPE

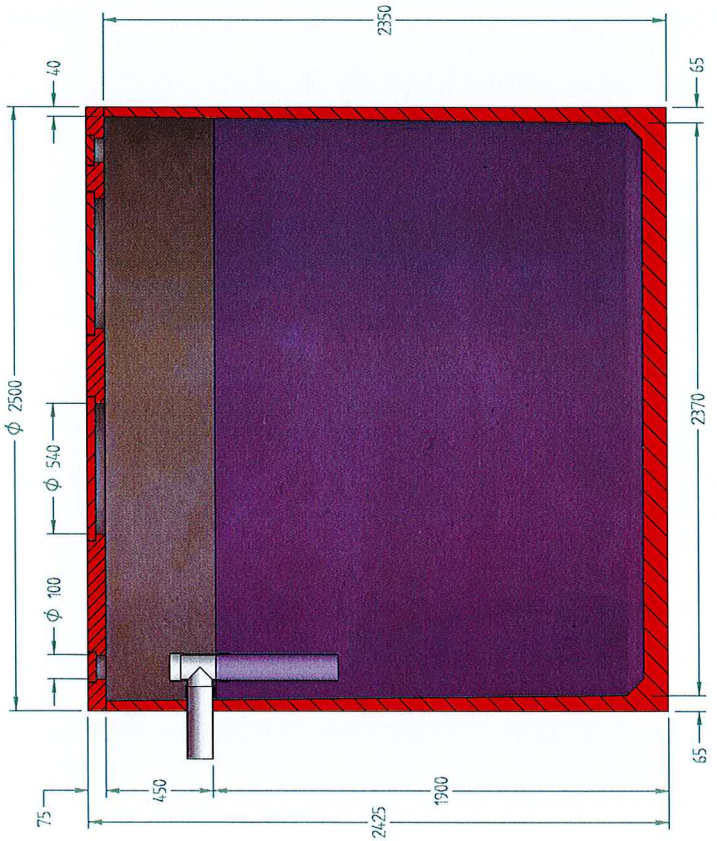

SECTION A-A

MASS: 4,061 kg

NOTES:

1. SEPTIC TANKS TO BE MANUFACTURED AND TESTED IN ACCORDANCE WITH AS/NZS 1546:2008
2. CONCRETE STRENGTH = 40MPa
3. CONCRETE TO BE VIBRATED TO ENSURE WELL COMPACTED CONCRETE
4. TANKS TO BE REINFORCED WITH FIBRE
5. 4 x 2.5 TONNE FOOT ANCHORS CAST INTO BASE OF THE TANK, 3 x 13 TONNE ANCHORS CAST INTO TANK LIDS

		DATE PLOTTED 6/10/2023	SCALE DO NOT SCALE	PROJECT -	TITLE 8000L COLLECTION WELL CERTIFICATION DRAWING	SHEET SIZE A3
			UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN MILLIMETRES	CON/TREAT: NONE	PART # 2500X2350-8000L-CW	VERSION V2
COPYRIGHT <small>REGISTRATION INFORMATION OBTAINED BY WASTE WATER AUSTRALIA PTY LTD AND IS THE PROPERTY OF WASTE WATER AUSTRALIA PTY LTD. UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN MILLIMETRES</small>		DRAWING LAST MODIFIED BY PETER MCKEY				